



Office of the Town Clerk
Diane M. Wilhelm

Registrar of Vital Statistics

Records Management Officer

Marriage Officer

TO: Supervisor Walter; Councilpersons Dunleavy; Wooten; Giglio; Hubbard; Robert Kozakiewicz, Town Attorney; Maryann Tague, Purchasing; Mark Conklin, Water Department

FROM: Julie O'Neill, Deputy Town Clerk

DATE: January 10, 2017

RE: Bid for Water Service Materials

1 bid was received and opened at 11:00 on January 10, 2017
See attached bid sheets

NY Plumbing Wholesale & Supply Inc.
Derek Price
595 Bruckner Blvd
Bronx NY 10455
212 678-4900x116
derek@nypsi.com



TOWN OF RIVERHEAD

Sean M. Walter, Supervisor

200 Howell Avenue

Riverhead, NY 11901-2596

631-727-3200

BID #RWD-2016-36A

BID FOR: WATER SERVICE MATERIALS

NY PLUMBING WHOLESALE & SUPPLY INC
BIDDERS NAME

595 BRACKNER BLVD,
BIDDERS ADDRESS

Bronx, NY 10455
CITY, STATE, ZIP

(212) 678-4900 ()
PHONE NUMBER FAX NUMBER

derek@nypsl.com
E-MAIL ADDRESS

In compliance with your advertisement for bids to be opened on **January 10, 2017**, subject to all conditions thereof, the undersigned hereby proposes to furnish the item(s) and/or service(s) itemized in this proposal in accordance with the Notice to Bidders, General Information Agreement and Specifications contained herein on the Bid Proposal Form attached.

Bidder certifies that the prices quoted herein do not include Federal Excise Tax or any Federal, New York State or City Sales Tax and are not higher than prices charged to any governmental or commercial consumer for like merchandise and/or service; and all prices include shipping and freight charges to any Municipal building or site within the Town of Riverhead.

Respectfully submitted,

[Signature]
SIGNED BY

Derek
TITLE

BIDDERS ARE INVITED TO ATTEND BID OPENING

I/WE FULLY UNDERSTAND THAT THE ACCEPTANCE OF THIS BID IS SUBJECT TO THE PROVISIONS OF SECTION 103A AND 103B OF THE GENERAL MUNICIPAL LAW.

JAN 6, 2017
DATE

NY PLUMBING WHOLESALE & SUPPLY INC
NAME OF AGENT/DEALER

595 BRECKNER BLVD
ADDRESS

BRONX, NY 10455
CITY, STATE, ZIP CODE

Derek Price
CONTACT PERSON

[Signature]
SIGNATURE OF DEALER/AGENT

BIDDER NAME: NY PLUMBING WHOLESALE & SUPPLY INC

BID SPECIFICATIONS FOR WATER SERVICE MATERIALS - BID #RWD-2016-36A

BIDDER NAME:		
ITEM #	DESCRIPTION	BID PRICE
24	Heavy duty frames & covers (see attached spec sheet) <i>PLAIN WATER</i>	\$ 264.71 \$ 202.71
143	Mueller 6" HC-2361-44-D-150 MJ cut-in valve.	\$ 1499.22
144	Mueller 8" HC-2361-44-D-150 MJ cut-in valve.	\$ 2316.65
145	Mueller 10" HC-2361-44-D-150 MJ cut-in valve.	\$ 1735.08
146	Mueller 12" HC-2361-44-D-150 MJ cut-in valve.	\$ 2195.56
192	Reflective fiberglass hydrant flag, plate-mount flat, 64" X .375", reflective red & white color	NB
193	Reflective mini flat, 4" X 5" for .375 shaft, reflective red & white color	NB
196	1 3/4" carbide-tip hole saw cutter	NB
197	1/4" carbide-tip pilot cutter	NB
198	Silver reflective paint (price per quart)	NB
199	Safety orange hydrant paint (Rust-Oleum enamel brush-on/roll-on only - price per gallon).	\$ 56.24
201	MA013922 food-grade anti-seize, 1 lb., or equal	NB
209	16" ductile iron valve box top flange top section with cover, domestic	NB
224	CST magnetic locator, Model 100, or equal	\$ 624.32

BIDDER NAME: NY PLUMBING WHOLESALE & SUPPLY INC

NYPS

NY Plumbing Wholesale & Supply, Inc.

933 Columbus Avenue - New York, NY 10025
 P: 212.678.4900 - F: 212.678.4901 - Web: nyplw.com

PRICE QUOTE

Page 1

Printed 01/09/17 DB

Quoted

Ship To

CASH CUSTOMER
 NY

Tel: Fax: 212-678-4901

TOWN OF RIVERHEAD
 Attn: DIANE M WILHELM
 OFFICE OF TOWN CLERK
 200 HOWELL AVENUE
 RIVERHEAD NY 11901

Quote #	Quote Date	Exp Date	Customer #	Customer P/O #	Ship Via	Writer
0007965	01/09/2017	04/09/2017	0001120			DB
Job ID	Customer Terms			Salesman		
	NET 30 DAYS			HOUSE ACCOUNT		

Product	Description	UM	Quant	Unit Price	Extension
	***** * BID SPECIFICATIONS FOR WATER * * MATERIALS - BID3 RWD-2016-36A * * *****				
SP	HEAVY DUTY PLAIN COVER 12441	EA	1	264.71	264.71
SP	HEAVY DUTY WATER MARK COVER	EA	1	202.71	202.71
SP	MUELLER 6" C-2362-44 CUTIN VAL	EA	1	1498.22	1498.22
SP	MUELLER 8" C-2362-44 CUTIN VAL	EA	1	2316.65	2316.65
SP	10" A2361-23 O/L MJ GATE W/2" SQUARE NUT	EA	1	1735.08	1735.08
SP	12" A2361-23 O/L MJ GATE W/2" SQUARE NUT	EA	1	2195.56	2195.56
SP	SAFETY ORANGE HYDRANT PAINT RUST-OLEUM ENAMEL BRUSH-ON/ROLL-ON ONLY PRICE PER GALLON	EA	1	56.24	56.24
SP	19-550 SMITH HAMILTON CST MAGNETIC LOCATOR	EA	1	624.32	624.32

Sub Total	\$8,893.49	T o t a l
Freight	\$0.00	
Misc Charges	\$0.00	
Tax Amount	\$0.00	
	\$8,893.49	

X: _____
 (Accepted by)


MESSAGE

DUE TO MARKET CONDITIONS PRICING
 MAY CHANGE PRIOR TO THE
 SPECIFIED EXPIRATION DATE ABOVE

TERMS


--

ITEM #24 SPECIFICATIONS

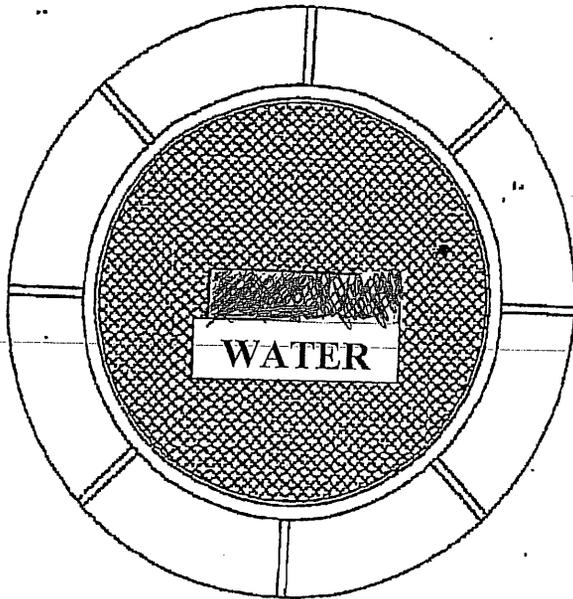

PLEASE SPECIFY.....

- SEWER
- STORM
- SANITARY SEWER
- DRAIN
- ELECTRIC
- PLAIN
- COMMUNICATION
- TELEPHONE
- OTHER — **WATER**
OR BLANK

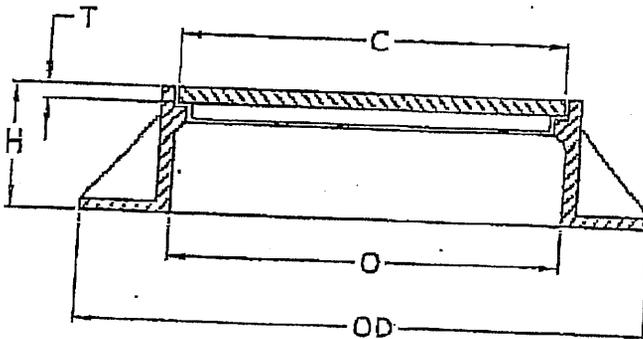

MODEL	C	H	O	OD	T
<input type="checkbox"/> 4001-A	24	3	22	34 OR 36	1 3/8 OR 1 1/4
<input checked="" type="checkbox"/> 4001-B	24	4	22	34 OR 36	1 3/8 OR 1 1/4
<input type="checkbox"/> 4001-C	24	6	22	34 OR 36	1 3/8 OR 1 1/4
<input type="checkbox"/> 4001-D	24	7	22	34 OR 36	1 3/8 OR 1 1/4
<input type="checkbox"/> 4001-E	24	8	22	34 OR 36	1 3/8 OR 1 1/4
<input type="checkbox"/> 4001-F	24	9	22	34 OR 36	1 3/8 OR 1 1/4


MATERIALS : CONFORMS TO ASTM A48 CLASS 30B OR 35B SPECIFICATIONS
 LOAD RATING : FOR A.A.S.H.T.O. & HS 20-44 HIGHWAY LOADING

HEAVY DUTY FRAMES & COVERS


Rev. 7-16 Shaded area indicates changes

- Catalog number--
 - C-2362-44** D-150 mechanical joint ends with accessories and duck tipped rubber gaskets†
 - C-2362-45** D-150 mechanical joint ends with accessories and plain tipped rubber gaskets†
 - C-2362-54** D-150 mechanical joint ends with accessories and duck tipped rubber gaskets† and bonding set screws in gland
 - C-2362-55** D-150 mechanical joint ends with accessories and plain tipped rubber gaskets† and bonding set screws in gland
- Sizes-- 4", 6", 8"
- Meets or exceeds all applicable requirements of ANSI/AWWA C509 Standard and is certified to ANSI/NSF 61
- Iron body with nominal 10 mils MUELLER[®] Pro-Gard™ Fusion Bonded Epoxy Coated interior and exterior surfaces
- Epoxy coating meets or exceeds all applicable requirements of ANSI/AWWA C550 Standard
- Iron wedge, symmetrical and fully encapsulated with molded rubber; no exposed iron
- Non-rising stem (NRS)
- Triple O-ring seal (2 upper & 1 lower O-ring)
- 2" square wrench nut - open left or open right
- 4" - 8" sizes--250 psig (1725 kPa/17 barg) maximum working pressure, 500 psig (3450 kPa/35 barg) static test pressure
- Mueller valves are designed for potable water applications

† See page 12.26 for extra gaskets and classes of pipe that cut-in valve will fit.

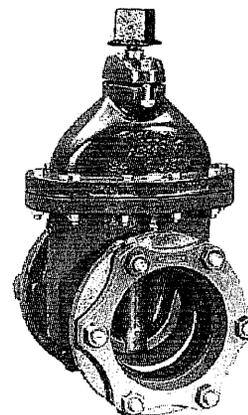

C-2362-44
D-150 M.J. accessories
shipped unassembled




Options

- Position indicators
- Stainless steel fasteners: Type 316
- Stainless steel stem: type 304 and type 316
- ASTM B98-C66100/H02 stem
- Handwheel
- EPDM disc and o-rings

Resilient Wedge Cut-In Valve Parts

Catalog Part Number	Description	Material	Material Standard
G-16	Bonnet bolts & nuts	304 Stainless Steel	ASTM F593 (bolt) ASTM F594 (nut)
G-41	Stuffing box bolt & nut	304 Stainless Steel	ASTM F593 (bolt) ASTM F594 (nut)
G-49	Stem o-rings (3)	Nitrile	ASTM D2000
G-200	Wrench nut cap screw	Stainless Steel	ASTM F593
G-201	Stuffing box seal	Nitrile	ASTM D2000
G-202	Wrench nut	Ductile Iron	ASTM A536 ▼
G-203	Stem	Bronze	ASTM B138
G-204	Handwheel (not shown)	Cast Iron +	ASTM A126 CL.B
G-205	Stem nut	Bronze	ASTM B62
G-206	Guide cap bearings	Acetal	-
G-207	Stuffing box	Cast Iron+	ASTM A126 CL.B
G-208	Anti-friction washer (2)	Acetal	-
G-209	Wedge, Rubber encapsulated	Ductile Iron*** SBR	ASTM A536 ▼ ASTM D2000
G-210***	Bonnet	Ductile Iron	ASTM A536 ▼
G-211***	Bonnet gasket	Nitrile	ASTM D2000
G-212***	Body	Ductile Iron	ASTM A536 ▼

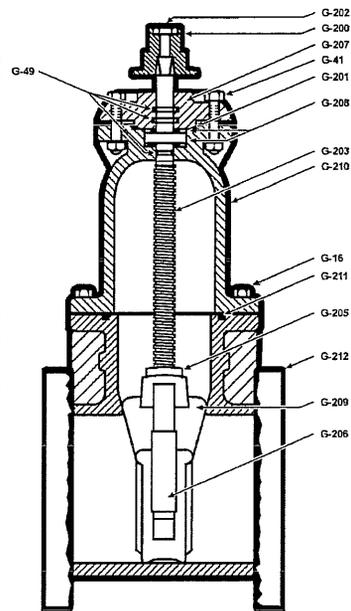

* Fully encapsulated in molded rubber with no iron exposed


** Previous to 1999 these parts on 4"-8" valves were designed with a gasket instead of an O-ring and with additional bolts. Confirm the type of seal when ordering a replacement gasket or O-ring.

+ Manufacturers option to change material to Ductile Iron ASTM A536

▼ Material strength ASTM A536 65-45 minimum

Rev. 4-14

- Catalog number—
 - A-2361-20** Mechanical joint ends (with accessories unassembled)
 - A-2361-23** Mechanical joint ends (less accessories)
 - A-2361-25** Mechanical joint ends (with transition gaskets accessories unassembled)
- Sizes – 4", 6", 8", 10", 12"
- Meets or exceeds all applicable requirements of ANSI/AWWA C515 Standard, UL Listed, FM Approved, and certified to ANSI/NSF 61.
- Standard mechanical joint ends comply with ANSI/AWWA C111
- Iron body with nominal 10 mils MUELLER® Pro-Gard® Fusion Epoxy Coated interior and exterior surfaces
- Epoxy coating meets or exceeds all applicable requirements of ANSI/AWWA C550 Standard.
- Iron wedge, symmetrical & fully encapsulated with molded rubber; no exposed iron
- Non-rising stem (NRS)
- Triple O-ring seal stuffing box (2 upper & 1 lower O-rings) with fourth o-ring serving as dirt seal
- 2" square wrench nut (optional handwheel available)—open left or open right
- 350 psig (2400 kPa/24 barg) maximum working pressure, 700 psig (4800 kPa/48 barg) static test pressure
- UL Listed, FM Approved: 350 psig (2400 kPa/24 barg)
- Mueller valves are designed for potable water application

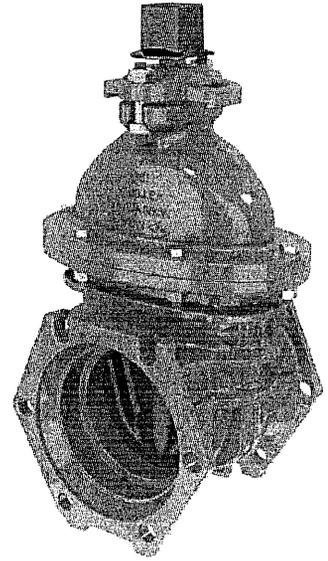

A-2361-20


Options

See page 10.46 for more information on Resilient Wedge Gate Valve options

- Position indicators
- Stainless steel fasteners: Type 316
- Stainless steel stem: Type 304, Type 316
- ASTM B98-C66100/H02 stem
- Handwheel
- EPDM Disc and o-rings

Resilient wedge gate valve parts

Catalog Part No.	Description	Material	Material Standard
G-16	Bonnet Bolts & Nuts	304 Stainless Steel	ASTM F593 (bolt) ASTM F594 (nut)
G-41	Stuffing Box Bolts & Nuts	304 Stainless Steel	ASTM F593 (bolt) ASTM F594 (nut)
G-49	Stem O-rings (3)	Nitrile	ASTM D2000
G-200	Wrench Nut Cap Screw	304 Stainless Steel	ASTM F593
G-201	Stuffing Box O-ring	Nitrile	ASTM D2000
G-202	Wrench Nut	Ductile Iron	ASTM A536 ▼
G-203	Stem	Bronze	ASTM B138
G-204	Hand Wheel (not shown)	Cast Iron	ASTM A126 CL.B
G-205	Stem Nut	Bronze	ASTM B584
G-206	Guide Cap Bearings	Acetal	-
G-207	Stuffing Box with dirt seal	Ductile Iron Nitrile	ASTM A536 ▼ ASTM D2000
G-208	Anti-friction Washers (2)	Acetal	-
G-209	Wedge, Rubber Encapsulation	Ductile Iron* SBR	ASTM A536 ▼ ASTM D2000
G-210**	Bonnet	Ductile Iron	ASTM A536 ▼
G-211**	Bonnet gasket	Nitrile	ASTM D2000
G-212**	Body	Ductile Iron	ASTM A536 ▼

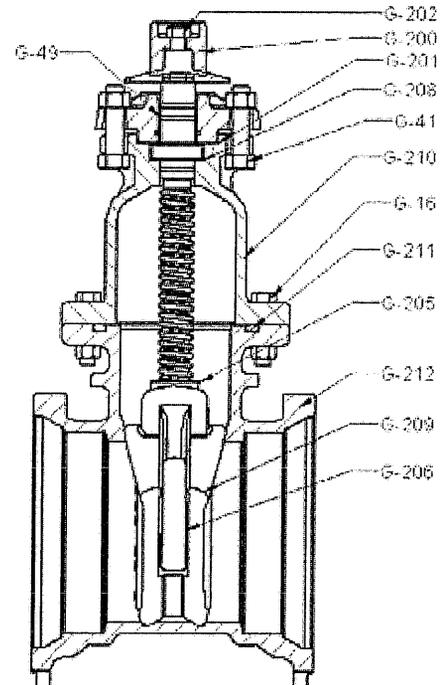

*Fully encapsulated in molded rubber with no iron exposed

▼ Material strength ASTM A536 65-45-12 minimum

BID #RWD-2016-36A
WATER SERVICE MATERIALS

NON-BIDDER'S RESPONSE

VENDOR NAME: Kemira Water Solutions

For purposes of facilitating your firm's response to our invitation to bid, the Town of Riverhead is interested in ascertaining reasons for prospective bidders' failure to respond to invitations to bid. If your firm is not responding to this bid, please indicate the reason(s) by checking the appropriate item(s) below and returning this form to the Town of Riverhead Purchasing department at 200 Howell Ave., Riverhead, N.Y. 11901.

We are not responding to this invitation to bid for the following reason(s):

Items or materials requested not manufactured by us or not available to our company.

Our items and/or materials do not meet specifications.

Specifications not clearly understood or applicable (too vague, too rigid, etc.)

Quantities too small.

Insufficient time allowed for preparation of bid.

Incorrect address used.

Correct address is: _____

Other reason(s): _____

BIDDER NAME: Michelle Bart
Bids Assistant