

RIVERHEAD WATER DISTRICT  
\*\* ADDENDUM No. 1 \*\*  
March 9, 2018

PROJECT No.: RDWD 17-02

PROJECT NAME: BOOSTER PUMPING STATION AT PLANT NO. 15

BID DATE: THURSDAY, MARCH 15, 2018 AT 11:00 A.M. EST (NO CHANGE)

Modifications:

1. **Contract G Modifications:**

a. *Section 004116 – Proposal – Contract G:* On page 004116-5, delete the first sentence in paragraph three and replace with the following verbiage: "All work specified under this contract shall be substantially complete and ready for final payment by September 21, 2018, and shall be ready for final payment by October 30, 2018."

2. **Contract E Modifications:**

a. *Section 004117 – Proposal – Contract E:* On page 004117-3, delete the first sentence in paragraph three and replace with the following verbiage: "All work specified under this contract shall be substantially complete and ready for final payment by September 21, 2018, and shall be ready for final payment by October 30, 2018."

- b. Replace Drawing E1.1 with revised Drawing E1.1
- c. Replace Drawing E9.0 with revised Drawing E9.0
- d. Replace Drawing E11.0 with revised Drawing E11.0
- e. Replace Drawing E12.0 with revised Drawing E12.0

To verify receipt of this Addendum, the contractor must sign and date this sheet and return immediately via fax or email (preferable). **A copy shall also be included with the bid submission documents.**

To: Andrew M. Manfredi, Project Engineer at H2M  
Fax No.: (631) 694-4122  
Email: [amanfredi@h2m.com](mailto:amanfredi@h2m.com)

Name: \_\_\_\_\_  
(Please Print)

Signature: \_\_\_\_\_

Company: \_\_\_\_\_

Date: \_\_\_\_\_





CONSULTANTS:

MARK	DATE	DESCRIPTION
▲	3/9/2018	ADDENDUM #1

DESIGNED BY:	DRAWN BY:	CHECKED BY:	REVIEWED BY:
CJS/CJD	MGL		
PROJECT No:	DATE:	SCALE:	
RDWD 17-02	MARCH 2018	AS SHOWN	

CLIENT

**Riverhead Water District**

**Booster Pumping Station at Plant No. 15**



Tuthills Lane, Jamesport


CONTRACT  
**CONTRACT E  
ELECTRICAL CONSTRUCTION**

STATUS  
**REGULATORY REVIEW**

SHEET TITLE  
**ELECTRICAL  
INSTRUMENTATION  
FLOOR PLAN**

DRAWING No.  
**E11.0**

SHEET No.  
**49**  
OF  
**51**

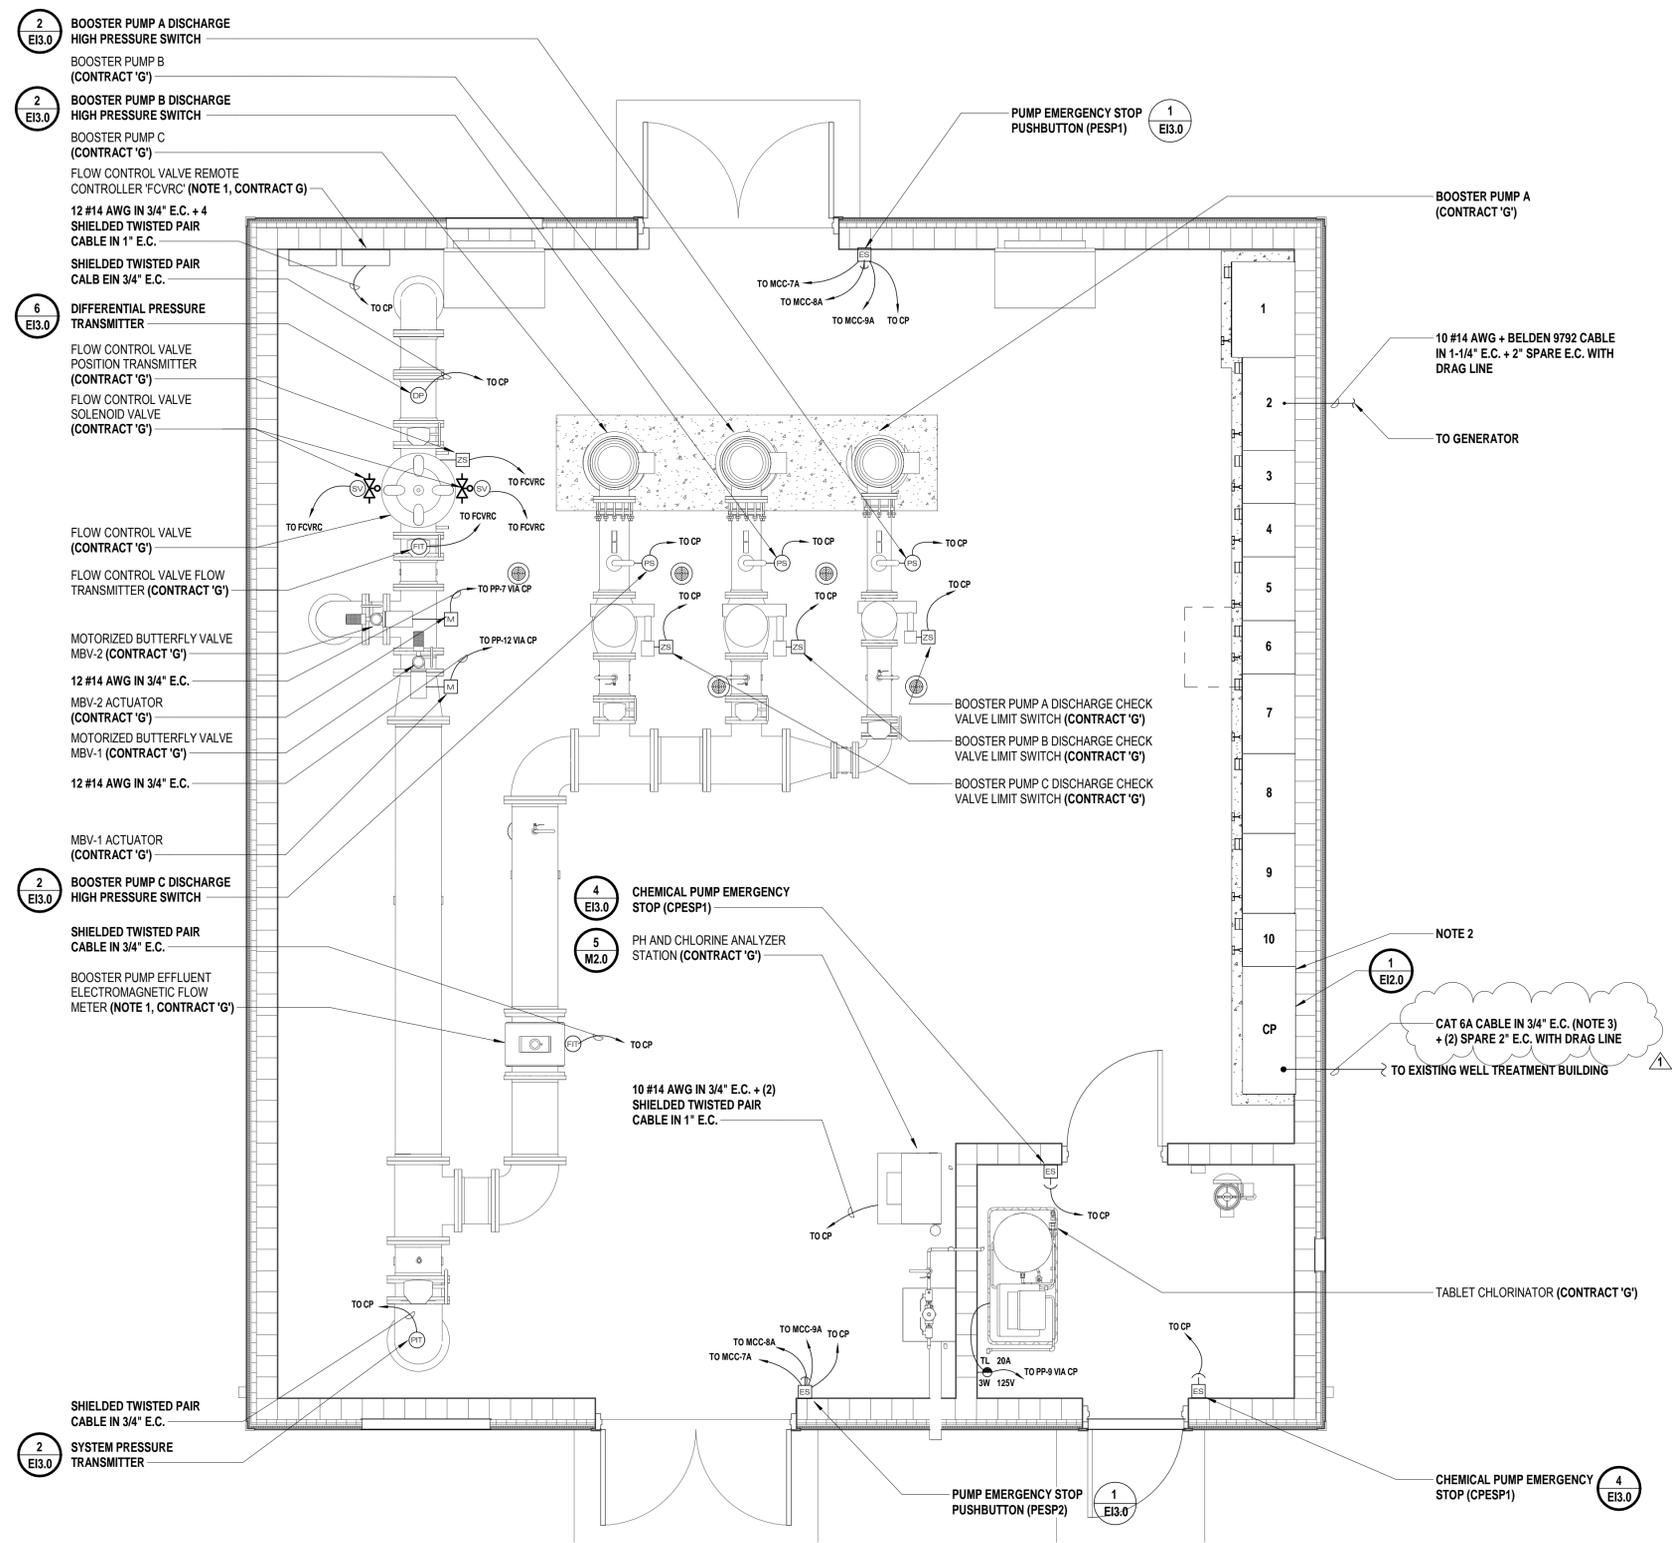

**ELECTRICAL KEY NOTE:**

- EQUIPMENT INDICATED SHALL BE PROVIDED BY CONTRACT 'G' AND WIRED BY CONTRACT 'E'.
- INTERCONNECTING WIRING BETWEEN MCC AND CONTROL PANEL IS NOT SHOWN. CONTRACTOR IS RESPONSIBLE TO PROVIDE AND INSTALL ALL INTERCONNECTING WIRING BETWEEN MCC AND CONTROL PANEL IN ACCORDANCE WITH SPECIFICATION 265011 AND 265012, AND CONTRACT DRAWINGS AS REQUIRED FOR COMPLETE CONTROL SYSTEM.
- NEW CAT 6A CABLE SHALL BE TERMINATED AT EXISTING ETHERNET SWITCH LOCATED WITHIN EXISTING WELL TREATMENT BUILDING. CONTRACTOR SHALL INTERFACE NEW PLANT NO. 15 WITH EXISTING ADMINISTRATION BUILDING PLC VIA EXISTING BROADBAND NETWORK CONNECTION TO COMMUNICATE ALL I/O POINTS AND SIGNALS INDICATED ON DRAWING EI2.0. CONTRACTOR IS RESPONSIBLE FOR ALL REQUIRED PROGRAMMING, ACCESSORIES, WIRING, CONDUIT, ETC. COORDINATE WITH DISTRICT IT/NETWORK STAFF AS REQUIRED FOR ALL IP ADDRESSES, PERMISSIONS, ETC. REQUIRED FOR COMPLETE COMMUNICATION IN ACCORDANCE WITH DISTRICT STANDARDS.

**1 Electrical Instrumentation Floor Plan**  
SCALE 3/8" = 1'-0"

